
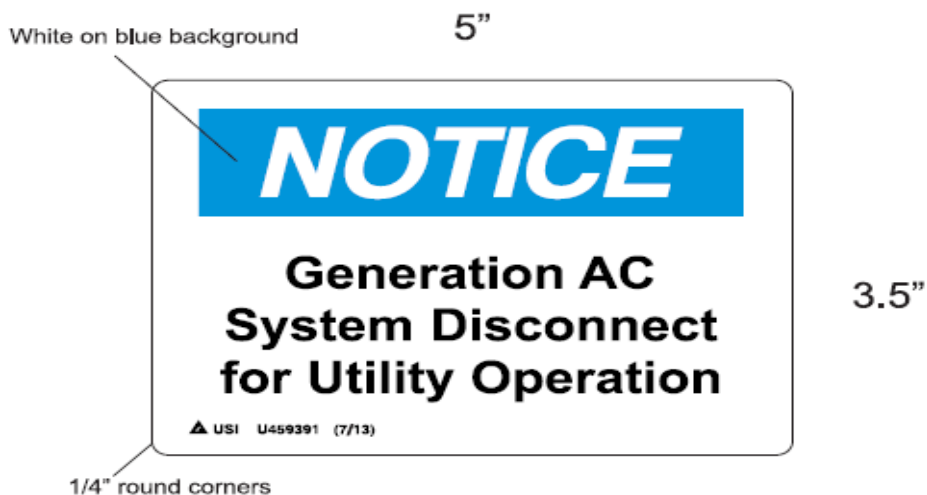


Technical Notice for Distributed Generation Interconnections

AC Isolation Device Labels

Refer to Section 3.1 of the Guidelines for Certified Inverter Based Generating Facilities regarding labeling of Isolation Devices. Be advised that the examples below are acceptable labels for the Generator Isolation Device.

For more information, call 866-324-2437 or email Distributed Resources [Distributed Resources@Eversource.com](mailto:Distributed_Resources@Eversource.com)

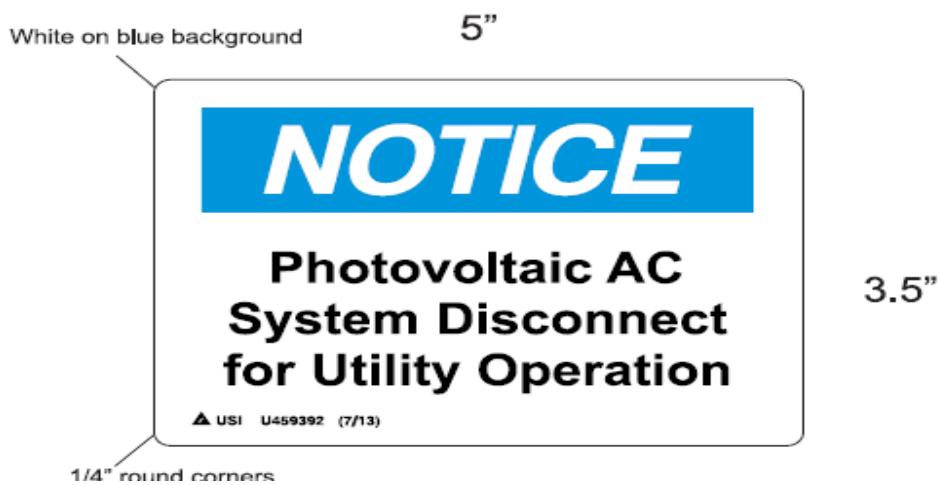

Material Specifications: UV stable materials and adhesive, suitable for outdoor environmental life cycle.